


POWER SYSTEM OPERATION CORPORATION LIMITED.

SOUTHERN REGIONAL LOAD DESPATCH CENTRE

FREQUENCY ANALYSIS FOR 05-08-2015

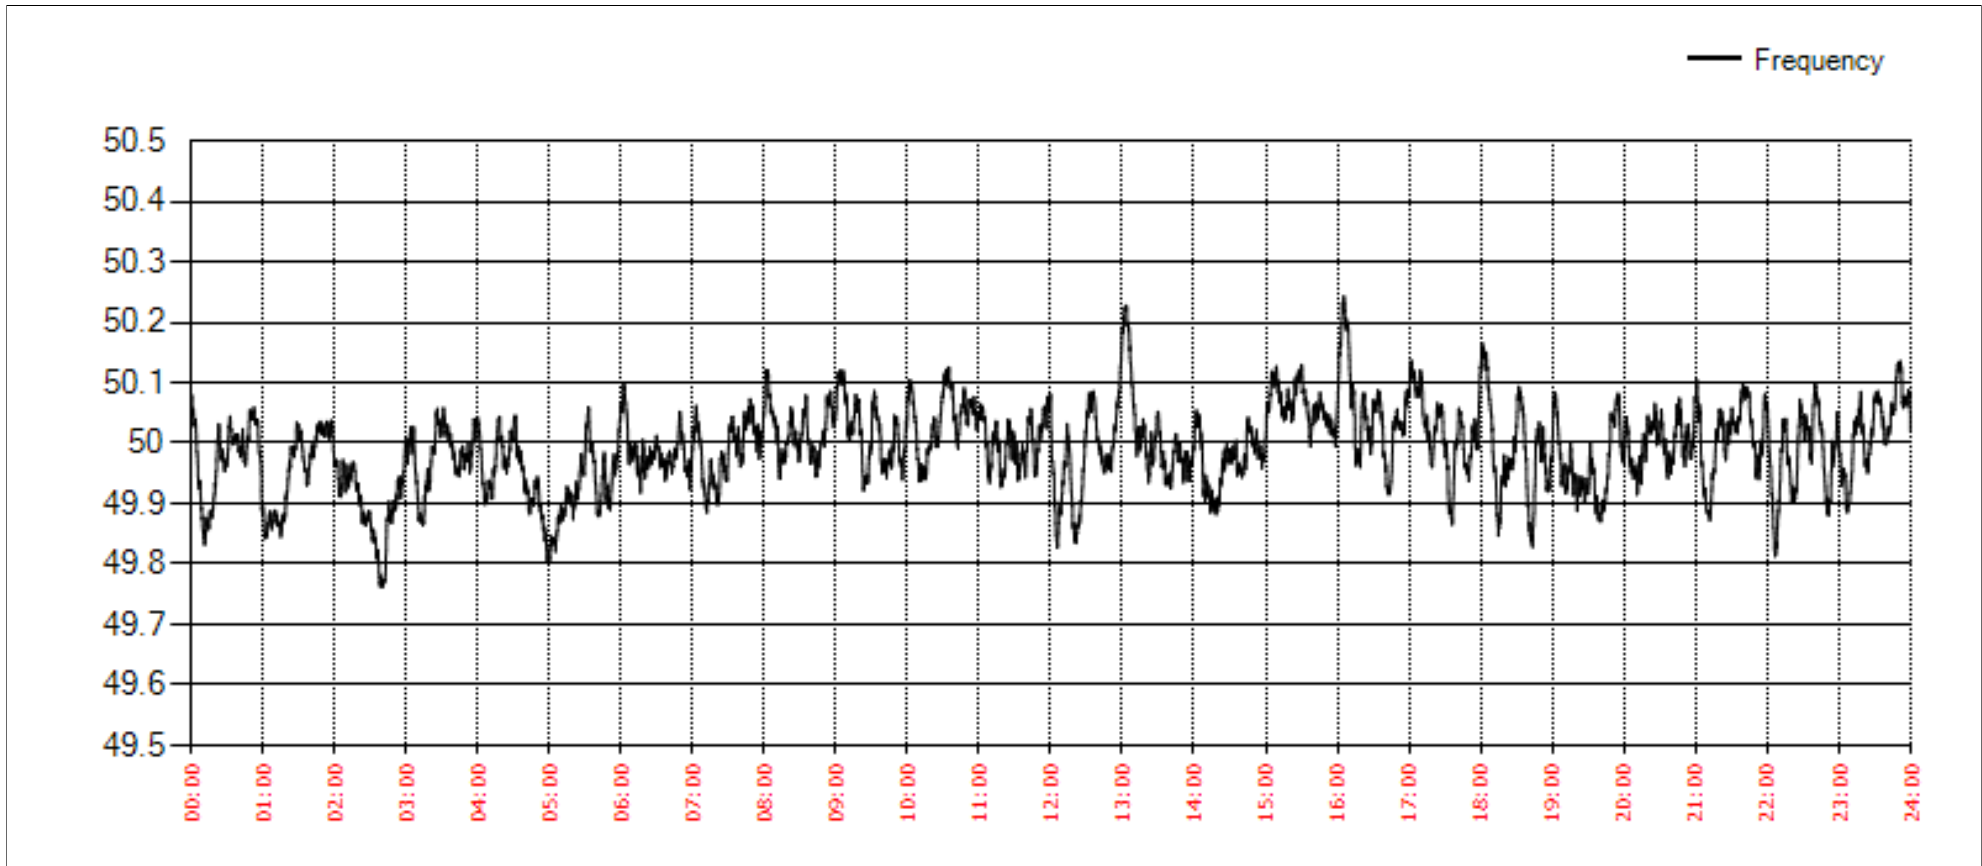

	<49.2	<49.7	49.7 to <49.8	49.8 to <49.9	<49.9	49.9 to <50.0	50.0 to <50.1	>=49.9 to <=50.05	>50.05 to <50.1	>50.05	>50.2	>=49.7 to <=50.2	>=49.97 to <=50.03
Minutes	0	0	35	839	874	3821	3576	6214	1186	1552	39	8601	3056
%	0.000	0.000	0.405	9.711	10.116	44.225	41.389	71.921	13.727	17.963	0.451	99.549	35.370

Average Frequency the Day:			49.99	Standard Deviation:			0.068	Frequency Deviation Index:			0.047
----------------------------	--	--	-------	---------------------	--	--	-------	----------------------------	--	--	-------

	INSTANTENEOUS	
	FREQUENCY	TIME
MAX	50.24	16:05:20
MIN	49.76	02:39:50

EXCURSION BELOW:				
49.0 HZ	49.2 HZ	49.5 HZ	49.7 HZ	49.9 HZ
0	0	0	0	54

	QUATERLY HOURLY AVERAGE	
	FREQUENCY	TIME
MAX	50.15	16:15
MIN	49.82	2:45